

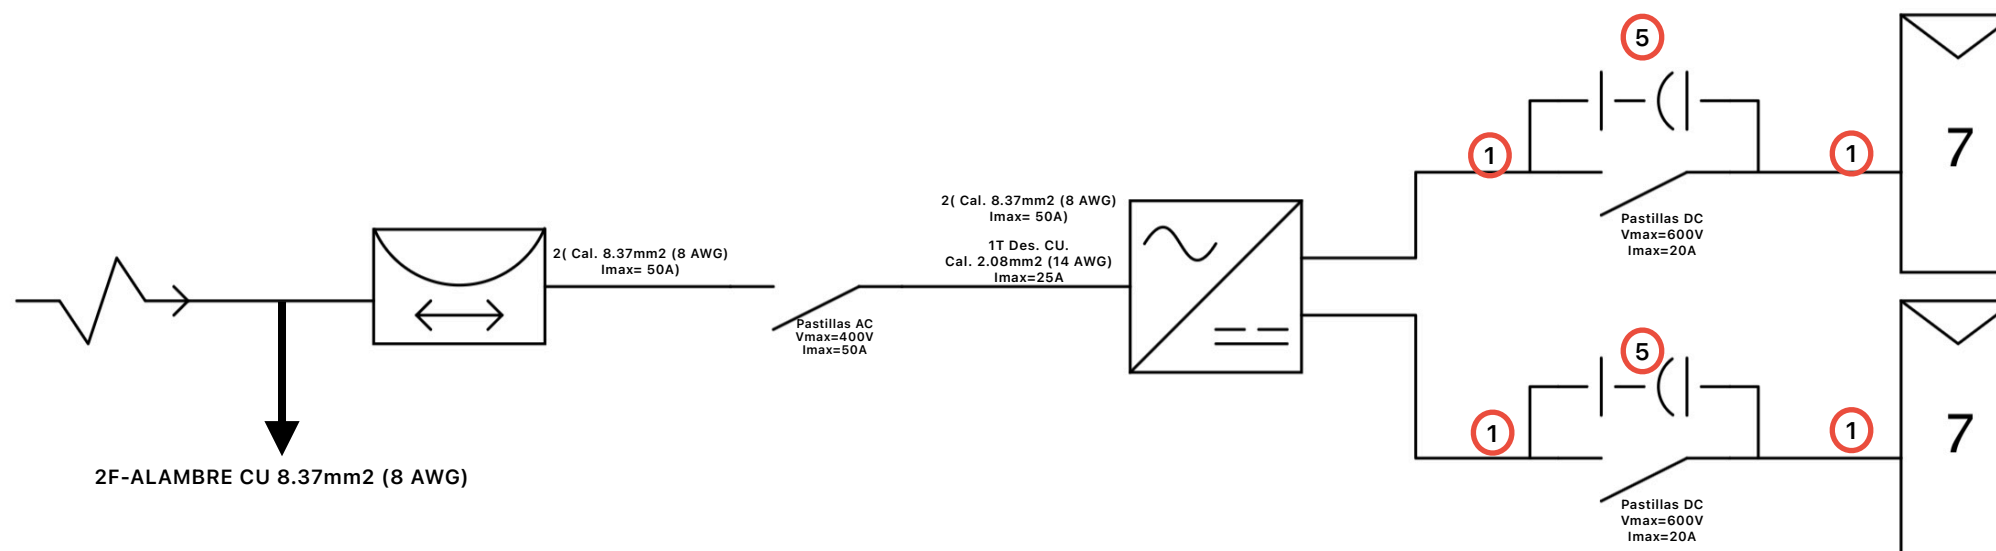


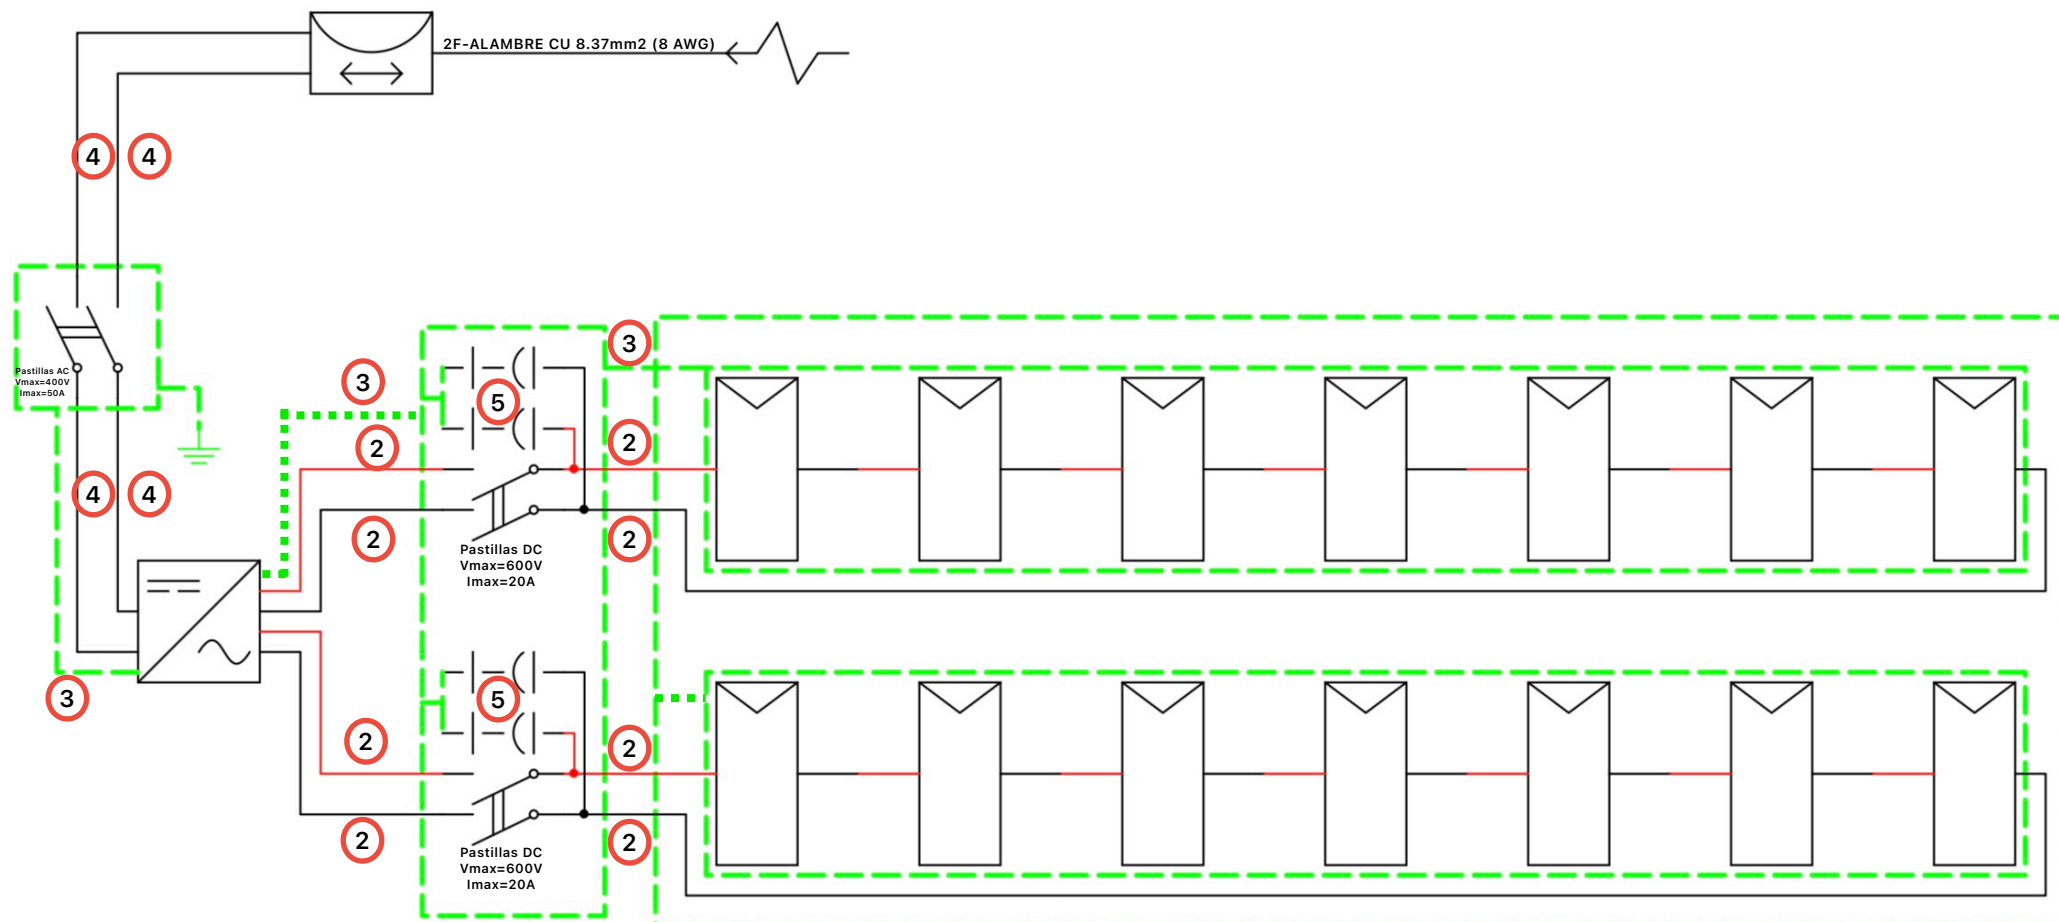

LOCALIZACIÓN

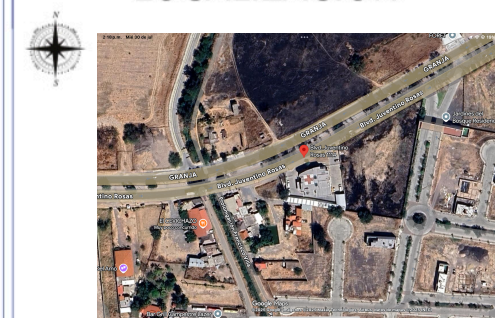

UBICACIÓN: Blvd. Juventino Rosas 1114A,
Rivera del río, 36333
San Francisco del Rincón, Gto.

NOTAS

	MODULO FV Pmax 620w Vmp 40.74V Voc 49.08V Imp 15.22A Isc 16.08A	1 2(Cal. 8.37mm2 (10 AWG) Imax= 40A) 1T Des. CU. Cal. 2.08mm2 (14 AWG) Imax=25A
	INVERSOR Pmax 10000W Vac 220V Iac 45.5	2 Cal. 8.37mm2 (10 AWG) Imax= 40A
	MEDIDOR BIDIRECCIONAL	3 1T Des. CU. Cal. 2.08mm2 (14 AWG) Imax=25A
	ACOMETIDA AÉREA 2 FASES - 3 HILOS 220 V 60 Hz	4 Cal. 8.37mm2 (8 AWG) Imax= 50A
	DC SURGE PROTECTOR Ucpv=600 V Imax=40 KA Up=2.8 KV	5

DIBUJÓ:	TEC. TADEO SIERRA
REVISÓ:	LIC. RENATA GURREA
APROBÓ:	ING. ANTHONY VALDEZ
PROPIETARIO:	
FECHA:	30/07/2025
ESCALA:	
CLAVE DE ARCHIVO:	

PROYECTO:	0580
NÚMERO DE PLANO	1
REVISIÓN:	